



PLAN VIEW - TYPICAL INSTALLATION

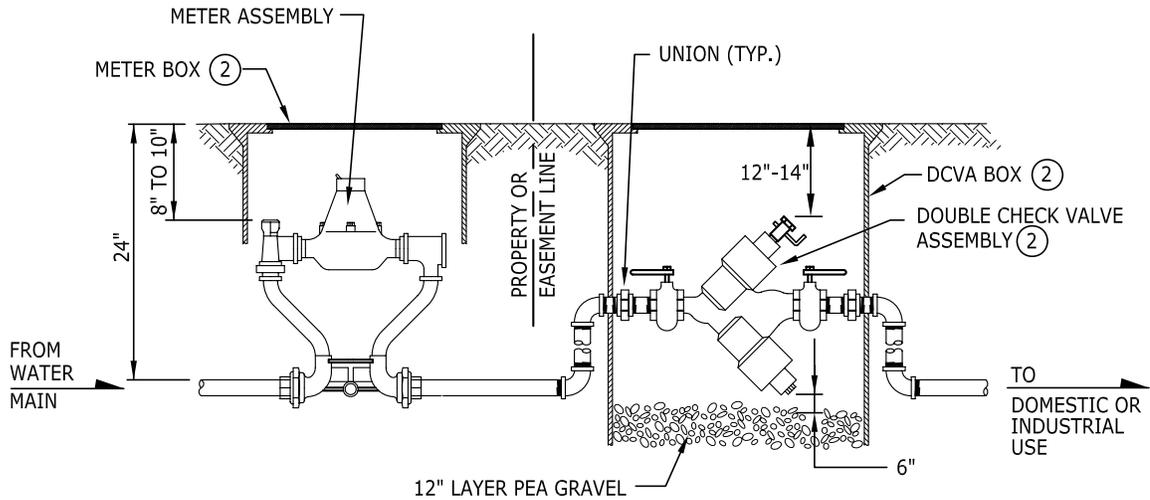

PROFILE VIEW - WATER SERVICE AND DOUBLE CHECK VALVE ASSEMBLY (LOW HAZARD)

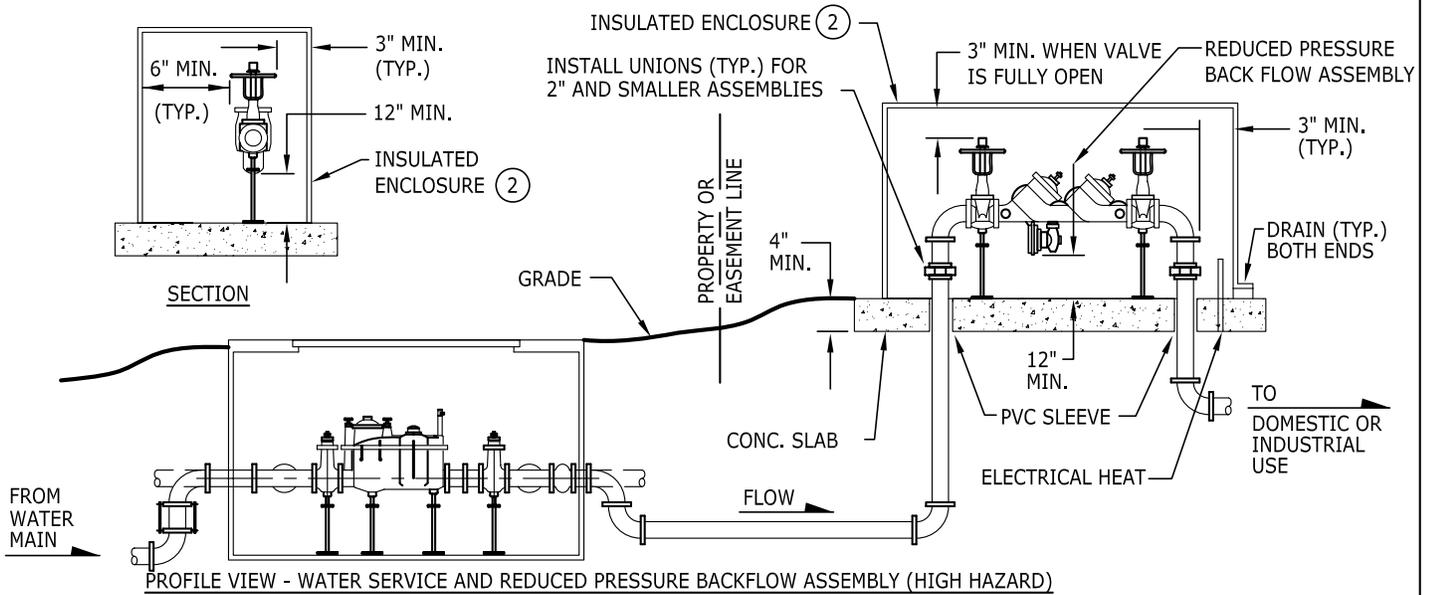

PROFILE VIEW - WATER SERVICE AND REDUCED PRESSURE BACKFLOW ASSEMBLY (HIGH HAZARD)

NOTES:

1. DRAWINGS ARE ILLUSTRATIONS ONLY. SIZE OF METER AND BACKFLOW PREVENTER SHALL BE PER THE APPROVED PLANS.
2. BOXES OR VAULTS SHALL PER SECTION 3.10.
3. INSULATED ENCLOSURES SHALL ALLOW MINIMUM CLEARANCES.
4. BACKFLOW PREVENTION SHALL BE PER SECTION 3.16.



NOTE: THIS PLAN IS NOT A LEGAL ENGINEERING DOCUMENT BUT AN ELECTRONIC DUPLICATE. THE ORIGINAL, SIGNED BY THE ENGINEER AND APPROVED FOR PUBLICATION IS KEPT ON FILE AT THE CITY OF KENT. A COPY MAY BE OBTAINED UPON REQUEST.

		CITY OF KENT ENGINEERING DEPARTMENT	
		DOMESTIC SERVICE CONNECTION PREMISE ISOLATION	
DESIGNED <u>DMW</u>	SCALE <u>NONE</u>	3-14	
DRAWN <u>BB</u>	DATE _____		
CHECKED _____	ENGINEER _____		
APPROVED _____			