


ELEVATION

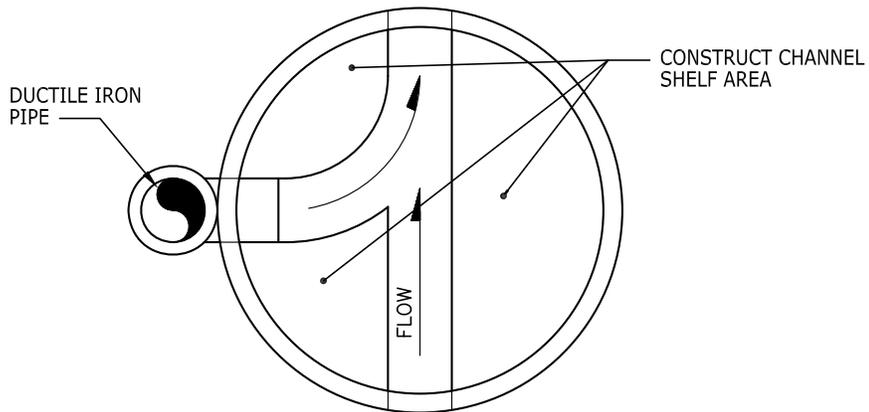


CHANNEL SECTION "A-A"

NOTES:

1. OUTSIDE DROPS MUST BE CONSTRUCTED W/ DUCTILE IRON AS SHOWN; CONC. ENCASED PVC IS NOT ACCEPTABLE.
2. USE RESTRAINED FITTINGS AT ALL DROP CONNECTION POINTS.
3. SNUG RETAINER GLAND AS CLOSE TO MANHOLE FACE AS PRACTICABLE.
4. IF DROP HEIGHT IS LESS THAN 2', A DROP CONNECTION IS NOT ALLOWED.

NOTE: THIS PLAN IS NOT A LEGAL ENGINEERING DOCUMENT BUT AN ELECTRONIC DUPLICATE. THE ORIGINAL, SIGNED BY THE ENGINEER AND APPROVED FOR PUBLICATION IS KEPT ON FILE AT THE CITY OF KENT. A COPY MAY BE OBTAINED UPON REQUEST.

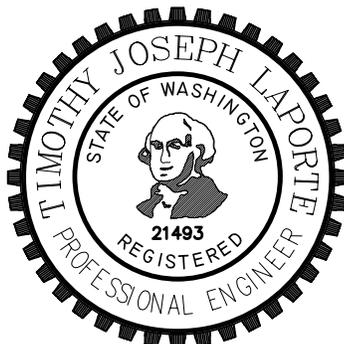

**CITY OF KENT
ENGINEERING DEPARTMENT**

**DUCTILE IRON DROP
CONNECTION**

DESIGNED DMW
DRAWN BB
CHECKED _____
APPROVED _____

SCALE NONE
DATE _____
ENGINEER _____

STANDARD PLAN

4-6